



**East St. Paul Water System  
2022 Annual Report**



March 8, 2023

Prepared for:

RM of East St. Paul  
3021 Bird's Hill Road  
East St. Paul, MB R2E 1A7

Prepared by:

Stantec Consulting Ltd.  
500-311 Portage Avenue  
Winnipeg, MB R3B 2B9

Project No. 111220211




**EAST ST. PAUL WATER SYSTEM  
2022 ANNUAL REPORT**


This document entitled East St. Paul Water System 2022 Annual Report was prepared by Stantec Consulting Ltd. ("Stantec") for the account of the Rural Municipality of East St. Paul (the "Client"). Any reliance on this document by any third party is strictly prohibited. The material in it reflects Stantec's professional judgment in light of the scope, schedule and other limitations stated in the document and in the contract between Stantec and the Client. The opinions in the document are based on conditions and information existing at the time the document was published and do not take into account any subsequent changes. In preparing the document, Stantec did not verify information supplied to it by others. Any use which a third party makes of this document is the responsibility of such third party. Such third party agrees that Stantec shall not be responsible for costs or damages of any kind, if any, suffered by it or any other third party as a result of decisions made or actions taken based on this document.

Prepared by \_\_\_\_\_  
  
(signature)

**Jamie Brewster, M.Sc.**

Reviewed by \_\_\_\_\_  
  
(signature)

**Saibal Basu, Ph.D., P.Eng.**

Approved by \_\_\_\_\_  
  
(signature)

**Saibal Basu, Ph.D., P.Eng.**



## Table of Contents

<b>1.0</b>	<b>WATER SYSTEM.....</b>	<b>1.1</b>
1.1	DESCRIPTION OF WATER SYSTEM.....	1.1
1.1.1	Groundwater Source.....	1.1
1.1.2	UV Disinfection.....	1.1
1.1.3	Chlorination.....	1.3
1.1.4	Treated Water Storage.....	1.3
1.1.5	Distribution Pumping.....	1.3
1.1.6	Distribution System.....	1.3
1.2	DISINFECTION.....	1.3
1.3	SAMPLING, TESTING AND REPORTING.....	1.4
1.3.1	Bacteriological Sampling.....	1.4
1.4	CHEMICAL AND RADIOLOGICAL PARAMETERS.....	1.5
1.4.1	Physical Parameters.....	1.6
1.4.2	Microbial Parameters.....	1.6
1.5	RECORD KEEPING.....	1.7
1.6	DRINKING WATER SAFETY ORDERS.....	1.7
1.7	BOIL WATER ADVISORIES.....	1.7
1.8	MAJOR EXPENSES INCURRED.....	1.7
1.9	UPCOMING EXPENSES.....	1.7

### LIST OF TABLES

Table 1.1 – Disinfection Testing Performance.....	1.4
Table 1.2 – Bacteriological Testing Performance.....	1.5
Table 1.3 – Raw and Treated Water Quality Data Collected in 2019 Relevant to the DWSA.....	1.5
Table 1.4 – Average Disinfection Byproduct Sampling Results (mg/L).....	1.6

### LIST OF FIGURES

Figure 1.0: Process Flow Diagram.....	1.2
---------------------------------------	-----



Water System  
March 2, 2023

## 1.0 WATER SYSTEM

### 1.1 DESCRIPTION OF WATER SYSTEM

The Rural Municipality of East St. Paul (RM) Water System consists of groundwater pumping, UV disinfection, chlorination, treated water storage, distribution pumping and distribution piping. Refer to **Figure 1.0** for a process flow diagram of the existing water system.

#### 1.1.1 Groundwater Source

Groundwater is conveyed to the water treatment plant (WTP) using two production wells (P-07 and P-08). P-08 is located east of the Floodway, off Oasis Road in the RM of Springfield, while P-07 is located adjacent to the WTP off Wenzel Street in the RM of East St. Paul.

Production well P-08 withdraws groundwater from a bedrock carbonate aquifer at a depth of approximately 43 meters below grade and can provide 20 L/s to the WTP. Water Rights License No. 2005-060 authorizes the withdrawal of 195,000 m<sup>3</sup>/yr at a maximum rate of 20 L/s from this well. Two (2) metering chambers measure the quantity of groundwater withdrawn from each aquifer. There is also a turbidity meter in each metering chamber to monitor the raw water turbidity of the groundwater source.

P-07 withdraws groundwater from the bedrock aquifer and can provide up to 19 L/s to the WTP. Water Rights License 2009-030 was issued July 16, 2009 and authorizes the withdrawal of 612,000 m<sup>3</sup>/yr at a maximum rate of 19 L/s from this well.


The RM is in the process of developing a new production well (P-10) at the Oasis Road well field.

#### 1.1.2 UV Disinfection

The raw water is disinfected by ultraviolet (UV) light. The intent of the UV disinfection process is to provide three log reduction credits for *Giardia* and *Cryptosporidium*. There are two completely redundant UV disinfection units that operate in duty / standby mode. The UV dose is automatically adjusted based on raw water flow.



V:\112\active\11216610\0300\_drawing\0301\_sketches\16610-fig1.0.dwg Fig. 1.0\_rev  
2020/05/05 8:25 AM By: Ramnarace, Kesh

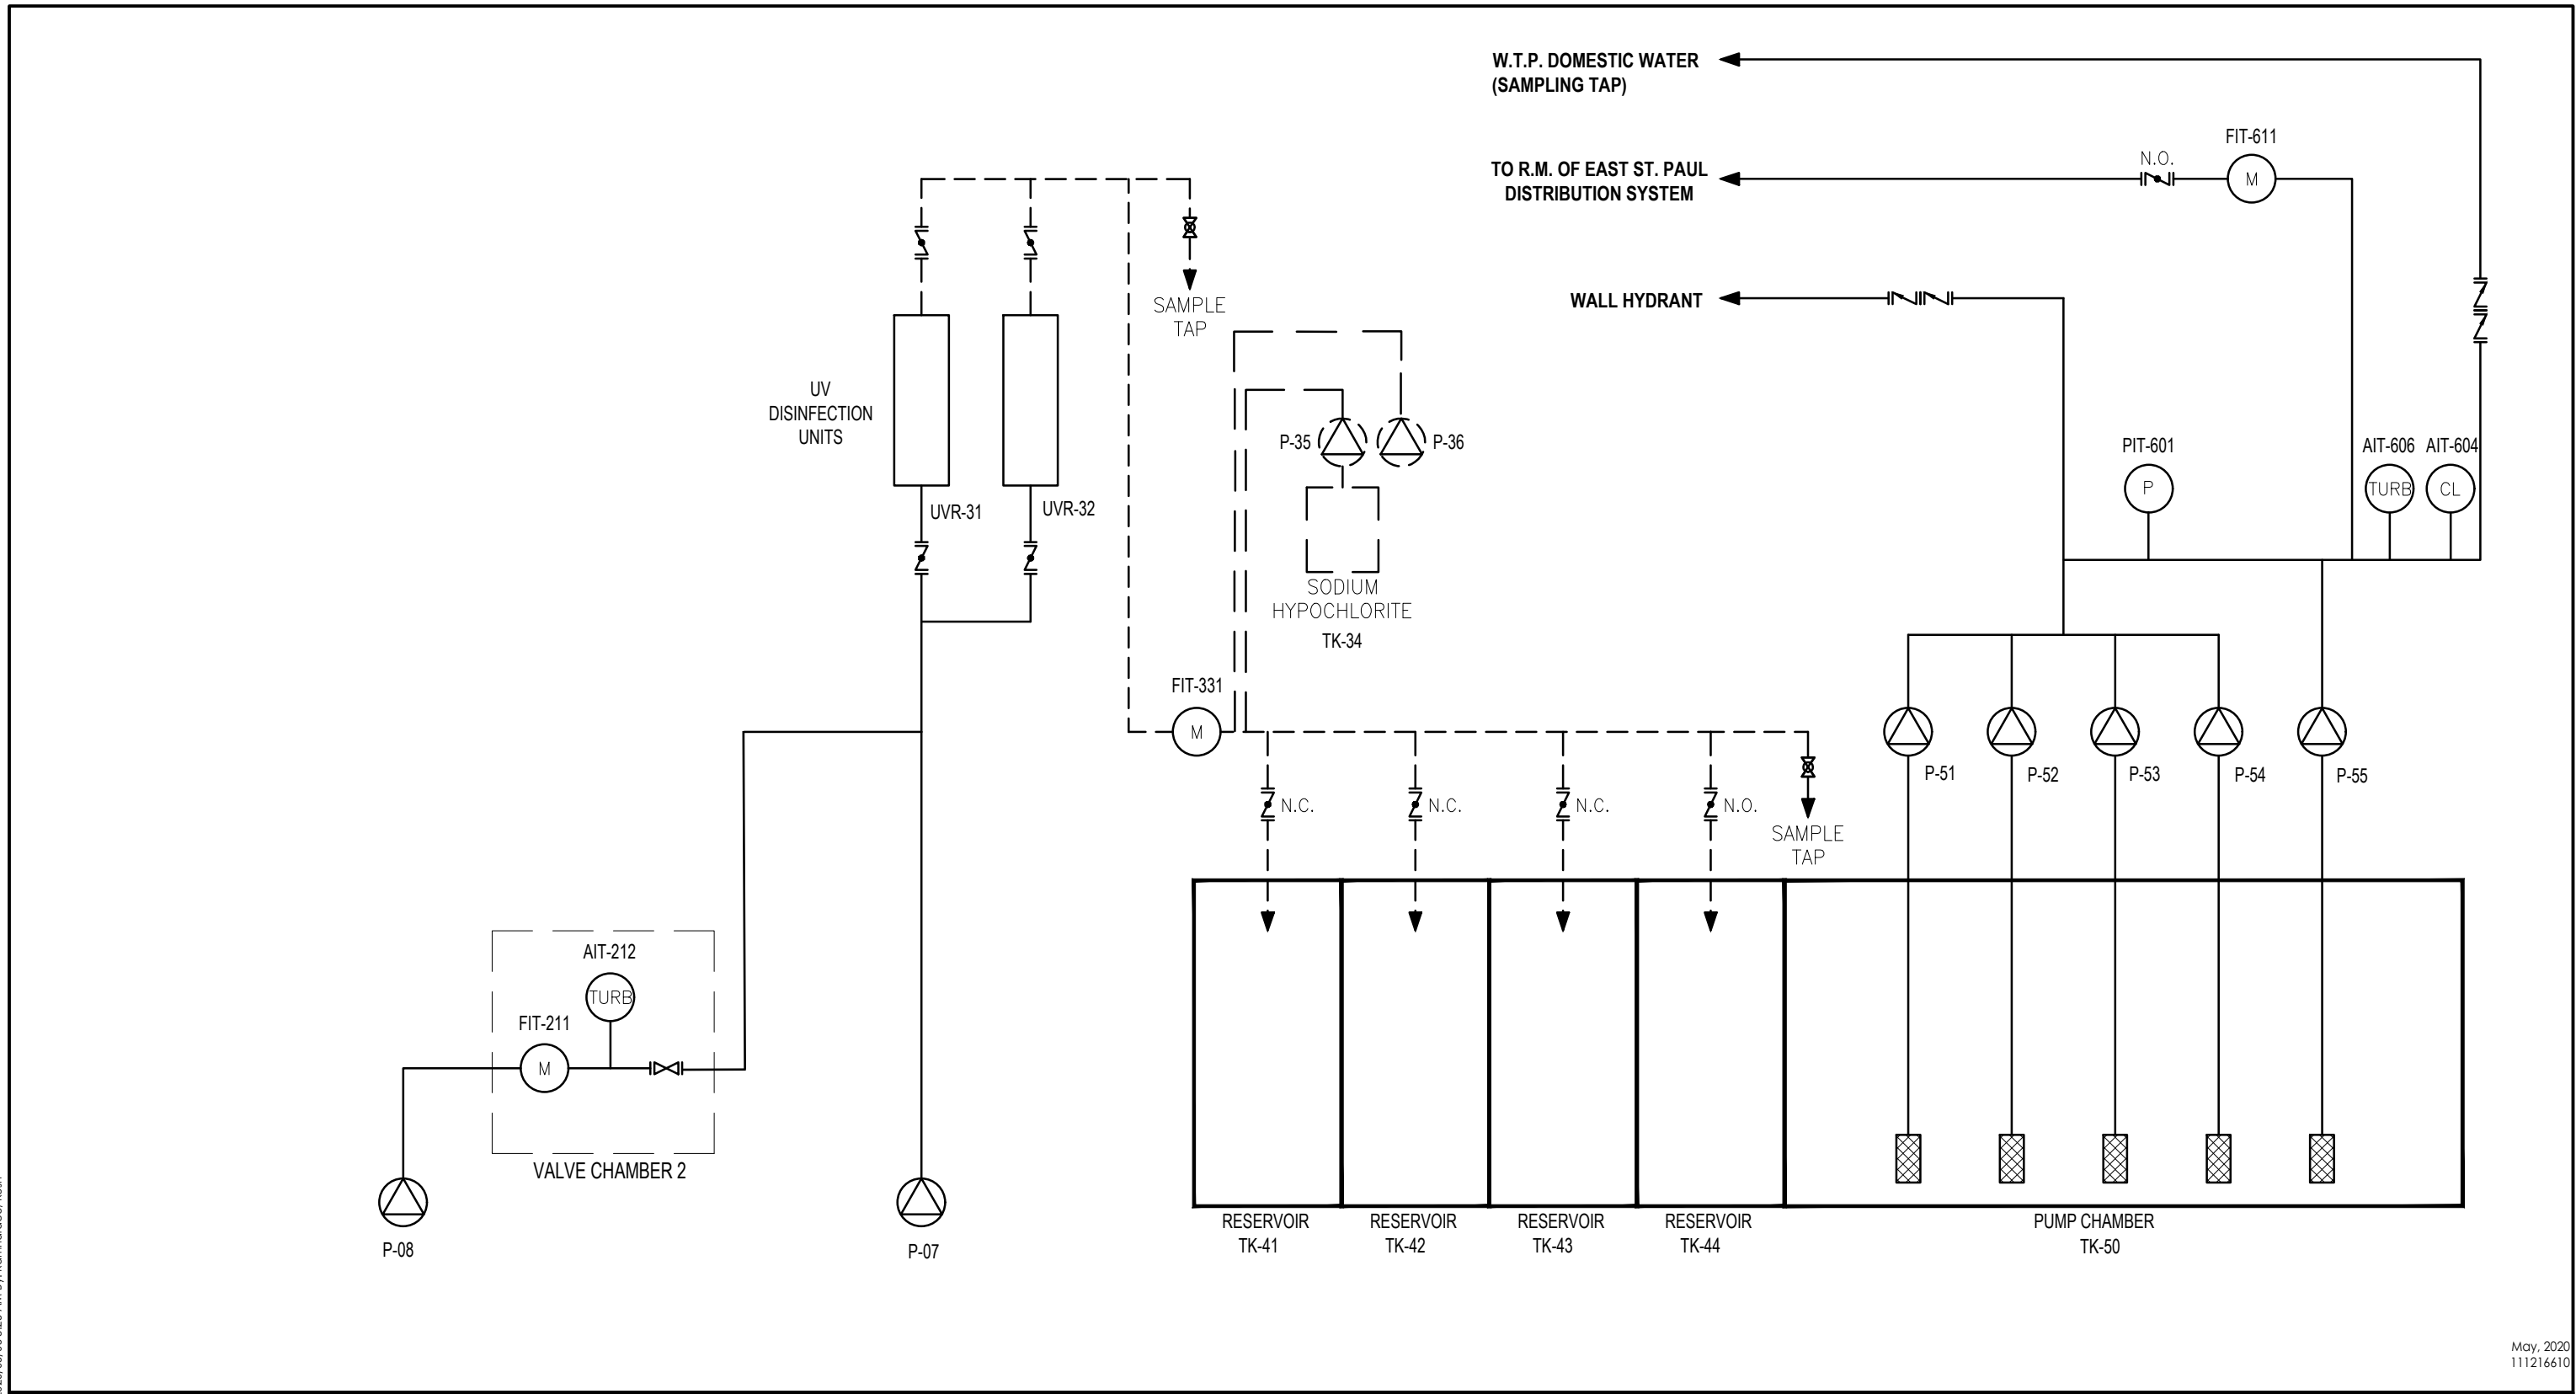

May, 2020  
11216610

**Stantec**  
Stantec Consulting Ltd.  
Suite 500, 311 Portage Avenue  
Winnipeg MB Canada R3B 2B9  
Tel. 204.489.5900 Fax. 204.453.9012  
www.stantec.com

Legend	
	RAW WATER
	POTABLE WATER
	CHEMICAL FEED
	TREATED WATER
	PUMP
	BACKFLOW PREVENTER
	RELIEF VALVE
	BUTTERFLY VALVE
	GATE VALVE
N.C.	NORMALLY CLOSED
N.O.	NORMALLY OPEN

Client/Project  
R.M. OF EAST ST. PAUL  
WATER SYSTEM  
Figure No.  
**1.0**  
Title  
**PROCESS FLOW DIAGRAM**

Water System  
March 2, 2023

### 1.1.3 Chlorination

The groundwater entering the plant is chlorinated prior to being discharged to a reservoir for storage. Liquid chlorine (sodium hypochlorite – 12%) is dosed to the groundwater using a chemical feed pump based on flow. The chlorine dose is manually adjusted based on the chlorine residual entering the distribution system.

### 1.1.4 Treated Water Storage

Treated water is stored in a four (4) cell reservoir. The reservoir buffers the peak instantaneous demands in the distribution system and also provides storage for fire protection. The total active storage volume is 2,895 m<sup>3</sup>.

### 1.1.5 Distribution Pumping

The distribution pumping system is made up of five (5) vertical turbine pumps. Two (2) domestic pumps (P-52 & P-53) each rated at 27 L/s, one high flow pump (P-54) rated at 53 L/s and two high flow pump (P-51 & P-55) each rated at 65 L/s. The total and firm pumping capacity is 237 L/s and 172 L/s, respectively. All distribution pumps are operated by variable frequency drives that vary to maintain a distribution system pressure of 65 psi in the header in the WTP.

### 1.1.6 Distribution System

The distribution system is comprised of approximately 37 km of PVC and HDPE. There are approximately 1,355 service connections in the distribution system as of December 31, 2022.

## 1.2 DISINFECTION

The raw water source is deemed surface water under the direct influence (GUDI) of surface water and therefore is required to provide:

- 3 log reduction for *Giardia* and *Cryptosporidium*
- 4 log reduction of viruses
- 20 minutes of chlorine contact time

UV and chlorine are both relied on for disinfection. UV provides 3 log reduction for *Giardia and Cryptosporidium*, while chlorine contract time provides 4 log reduction for viruses and satisfies the 20-minute contact time requirement for bacteria.

The operating license requires a minimum UV dose of 33 mJ/cm<sup>2</sup> for 95% of the readings in one month to provide 3 log reduction for *Giardia and Cryptosporidium*. The effectiveness of the UV system is tracked by monitoring UV intensity and calculating the UV dose based on an operator entered UV transmittance.



Water System  
March 2, 2023

The daily average, minimum and maximum UV dose is tracked and reported against the required UV dose to provide 3 log reduction of *Giardia and Cryptosporidium*.

The Drinking Water Safety Act (DWSA) also requires a minimum free chlorine residual entering the distribution system of 0.5 mg/L and a minimum free chlorine residual of 0.1 mg/L in the distribution system. The RM continuously measures the chlorine level entering the distribution system using an online analyzer and reports the reading every 5 minutes. The RM also manually measures the chlorine level entering the distribution system on a daily basis and the chlorine level at various locations in the distribution system on a biweekly basis.

The compliance with respect to monitoring the UV dose and chlorine residual is summarized in **Table 1.1**.

**Table 1.1 – Disinfection Testing Performance**

Description	Requirement	Compliance
Free Chlorine residual entering the distribution system based on manual daily sample	≥ 0.5 mg/L	100%
Free chlorine residual entering the distribution system based on 5-minute sample results	≥ 0.5 mg/L	99.9% <sup>A</sup>
Frequency of testing daily at WTP	Daily	100%
Free Chlorine residual in the distribution system	≥ 0.1 mg/L	100%
Frequency of testing in the distribution system	weekly	100%
Report Submission	Monthly	100%
UV dose	≥ 33 mJ/cm <sup>2</sup> (95% / month)	100% <sup>B</sup>

<sup>A</sup> No data was tracked for a two-day period in May during PLC & SCADA system integration, which is not included in the compliance reporting. The other instances where a residual < 0.5 mg/L was recorded are a result analyzer maintenance and cleaning.

<sup>B</sup> No data was tracked for a two-day period in May during PLC & SCADA system integration, which is not included in the compliance reporting.

## 1.3 SAMPLING, TESTING AND REPORTING

### 1.3.1 Bacteriological Sampling

While the RM is required to sample the raw water entering the WTP, treated water leaving the WTP and treated water in the distribution system on a biweekly basis, the RM samples weekly in an effort to be proactive. Samples are sent to ALS Laboratory Group for Total Coliform and E. Coli testing.

Total coliform was detected in the raw water entering the WTP in 8 of 52 samples. E. Coli was not detected in the raw water in any samples. Total coliform or E. Coli was not detected in treated water



Water System  
March 2, 2023

leaving the WTP or the distribution samples collected weekly in 2022. Sampling results for the treated water are summarized in **Table 1.2** as follows:

**Table 1.2 – Bacteriological Testing Performance**

Description	Requirement	Results	Compliance
Sampling Frequency	Bi-weekly	Weekly	100%
Total Coliform	< 1 MPN / 100 mL	0	100%
E. Coli	< 1 MPN / 100 mL	0	100%

## 1.4 CHEMICAL AND RADIOLOGICAL PARAMETERS

The RM is required to sample and test for chemical and radiological parameters once every year. The RM completed the sampling on May 26, 2022. The results for key parameters related to the Guideline for Canadian Drinking Water Quality (GCDWQ) aesthetic objectives (AO) and the DWSA maximum acceptable concentration (MAC) are summarized in **Table 1.3**.

**Table 1.3 – Raw and Treated Water Quality Data Collected in 2022 Relevant to the DWSA**

Parameter	Raw	Treated	[MAC] / AO
Total Alkalinity (mg/L as CaCO <sub>3</sub> )	253	241	N/A
pH	7.85	7.86	7.0 ~ 10.0
Colour (TCU)	138	< 5.0	≤ 15
Conductivity	731	672	N/A
Hardness (mg/L as CaCO <sub>3</sub> )	409	370	N/A
TDS (mg/L)	446	391	≤ 500
Turbidity (NTU)	< 0.1	< 0.1	≤ 1
Arsenic (mg/L)	0.00021	0.00021	[0.01]
Fluoride (mg/L)	0.196	0.183	[1.5]
Lead (mg/L)	0.000084	0.000152	[0.01]
Nitrate-N (mg/L)	0.0483	0.0648	[10]
Uranium (mg/L)	0.00359	0.00326	[0.02]
Iron (mg/L)	< 0.010	< 0.010	0.3





**EAST ST. PAUL WATER SYSTEM  
2022 ANNUAL REPORT**

Water System  
March 2, 2023

Parameter	Raw	Treated	[MAC] / AO
Manganese (mg/L)	0.00234	0.001044	0.12 / [0.02]
Sodium (mg/L)	20.3	18.2	≤ 200
Zinc (mg/L)	0.0033	0.0061	≤ 5.0
Chloride (mg/L)	17.5	19.9	250
Sulphate (mg/L)	135	103	≤ 500
Total Organic Carbon(TOC)	1.33	1.14	N/A
UVT (%)	97.1	97.9	N/A

Since 2016 the RM has been required to take quarterly samples from the distribution system (February, May, August and November) that are to be analyzed for total trihalomethanes (TTHMs) and haloacetic acids (HAAs) every second year. The RM took four (4) samples in 2022 the results of which are summarized in **Table 1.4**. Based on the data presented, both THM and HAA are well within the MAC limits.

**Table 1.4 – Average Disinfection Byproduct Sampling Results (mg/L)**

Parameter	Jan 12	Jun 1	Sept 14	Dec 14	Average	MAC
Total Trihalomethanes (TTHMs)	0.0076	0.0148	0.0139	0.0139	0.013	0.1
Total Haloacetic Acids (HAAs)	0.0018	0.0024	0.0034	0.0034	0.0025	0.08

### 1.4.1 Physical Parameters

There are no physical limits specified in the RM's operating license, although the operating license does require the RM to take one sample per day of the raw water and analyze it for turbidity. Turbidity is also to be noted in the distribution system at the time of bacteriological sampling. The RM was 100% compliant with the requirement for daily raw water turbidity sampling. Based on the reported daily readings for 2022, the raw water turbidity was below the aesthetic objective of 1 NTU in all samples.

### 1.4.2 Microbial Parameters

The RM's operating license requires:

- 3 log reduction for *Giardia* and *Cryptosporidium*
- 4 log reduction of viruses



Water System  
March 2, 2023

- 20 minutes of chlorine contact time

UV disinfection satisfies the 3 log reduction requirement for *Giardia* and *Cryptosporidium*, while chlorine contact time in the reservoir satisfies the 20 minute chlorine contact time requirement and the 4 log reduction requirement for viruses.

## 1.5 RECORD KEEPING

The RM retains all the testing data and stores one copy at the WTP. Copies of the chlorination and UV data are submitted to the ODW on a monthly basis. Bacteriological testing results are also copied to the Regional Drinking Water Officer.

The Office of Drinking Water (ODW) has not yet completed the audit of the 2022 data.

## 1.6 DRINKING WATER SAFETY ORDERS

There were no drinking water safety orders issued to the RM in 2022.

## 1.7 BOIL WATER ADVISORIES

There were no boil water advisories issued to the RM in 2022.

## 1.8 MAJOR EXPENSES INCURRED

The WTP programmable logic controller (PLC) upgrade project was completed in 2022. The project included:

- Replacement of PLC and associated analogue components and relays at both WTP and Well Site
- Development of new PLC control logic program
- Replacement all existing communication systems at both WTP and Well Site
- Control panel replacements
- Supervisor Control and Data Acquisition (SCADA) system upgrades

## 1.9 UPCOMING EXPENSES

The RM is planning to complete the Production Well No.10 project in 2023 and is also planning to issue a request for proposals for a feasibility study regarding integration of the Bray Road Well Site to the water system.

